

Fig. 1

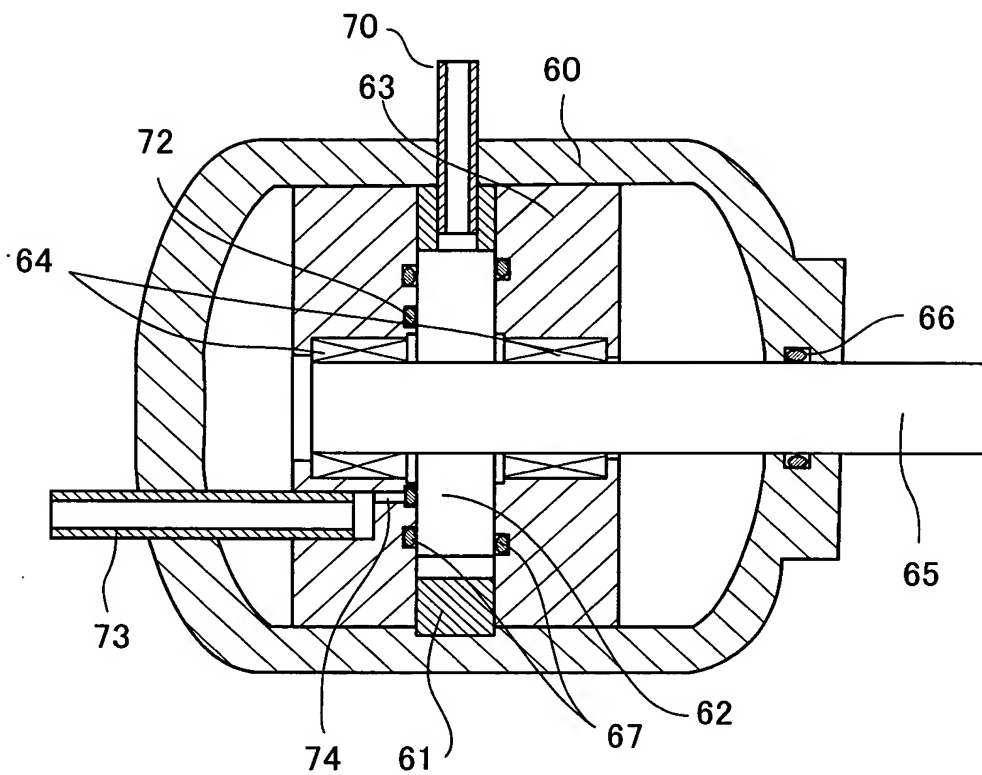


Fig. 2

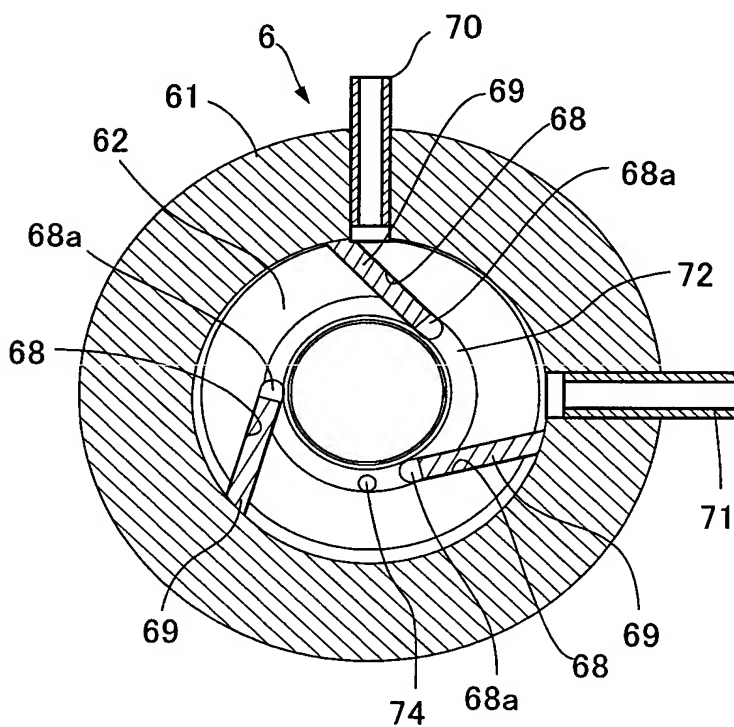


Fig. 3

At the time of
cooling operation

At the time of
heating operation

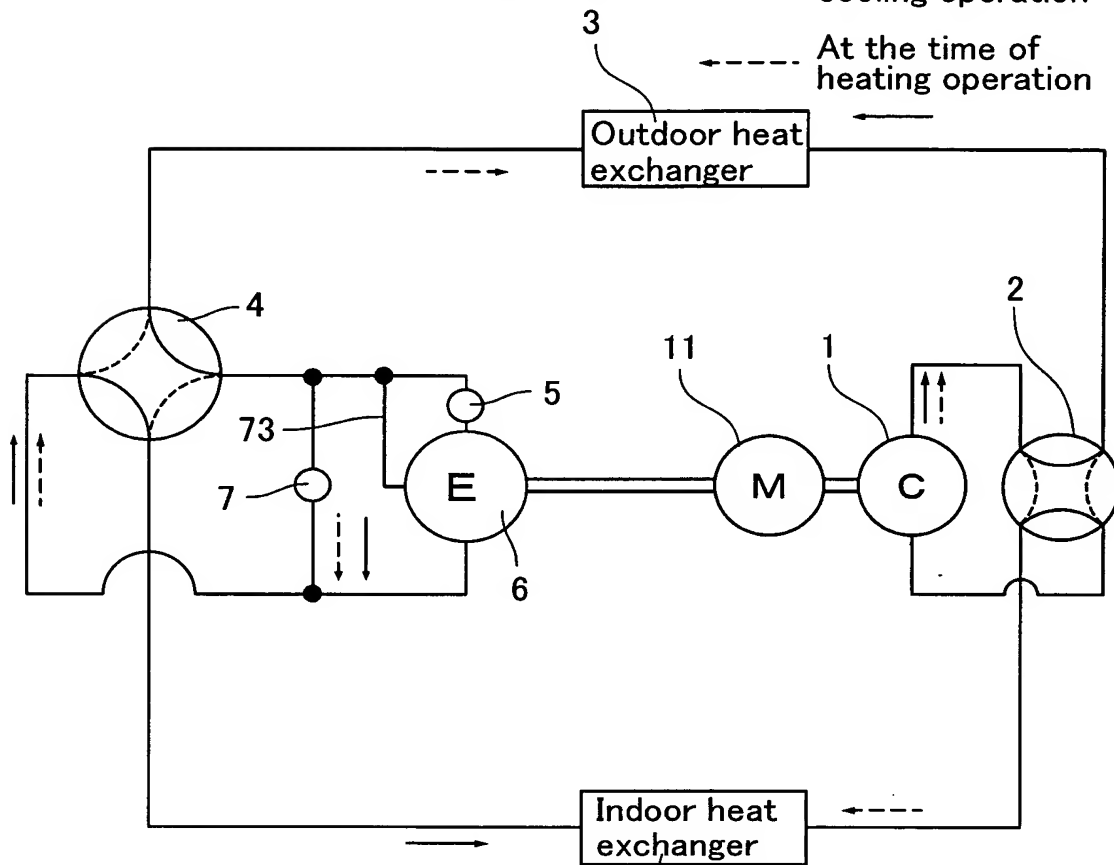


Fig. 4

At the time of cooling operation

At the time of
heating operation

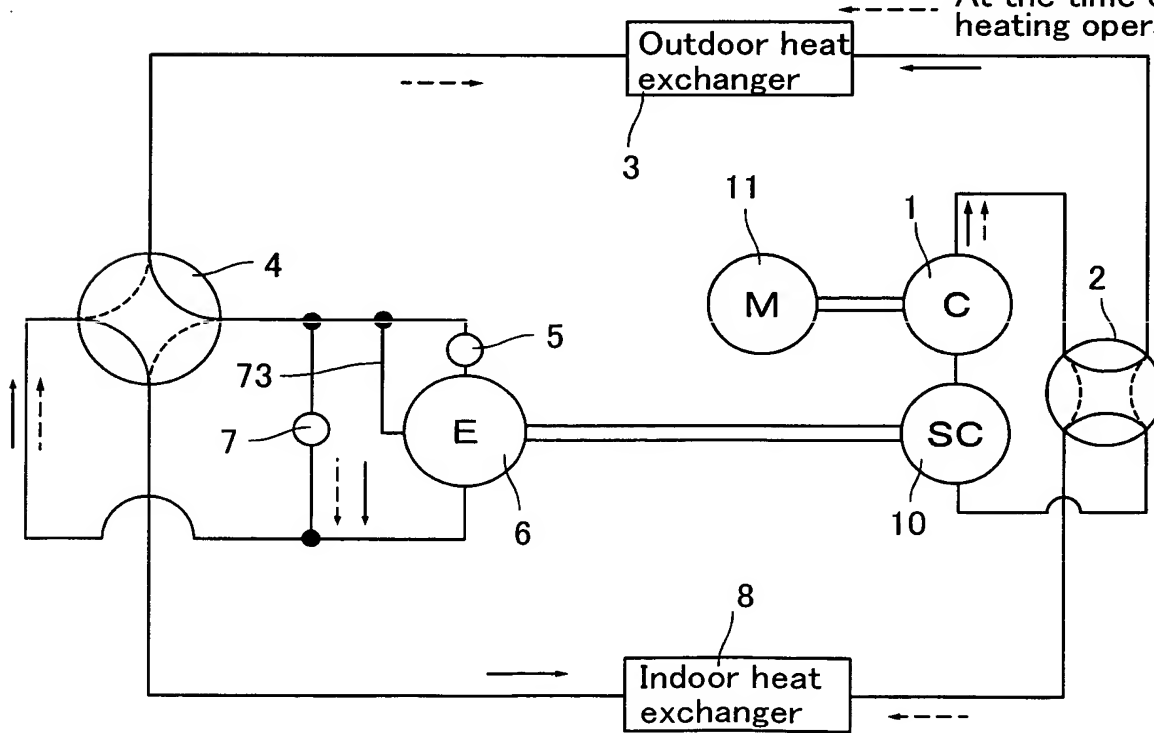


Fig. 5

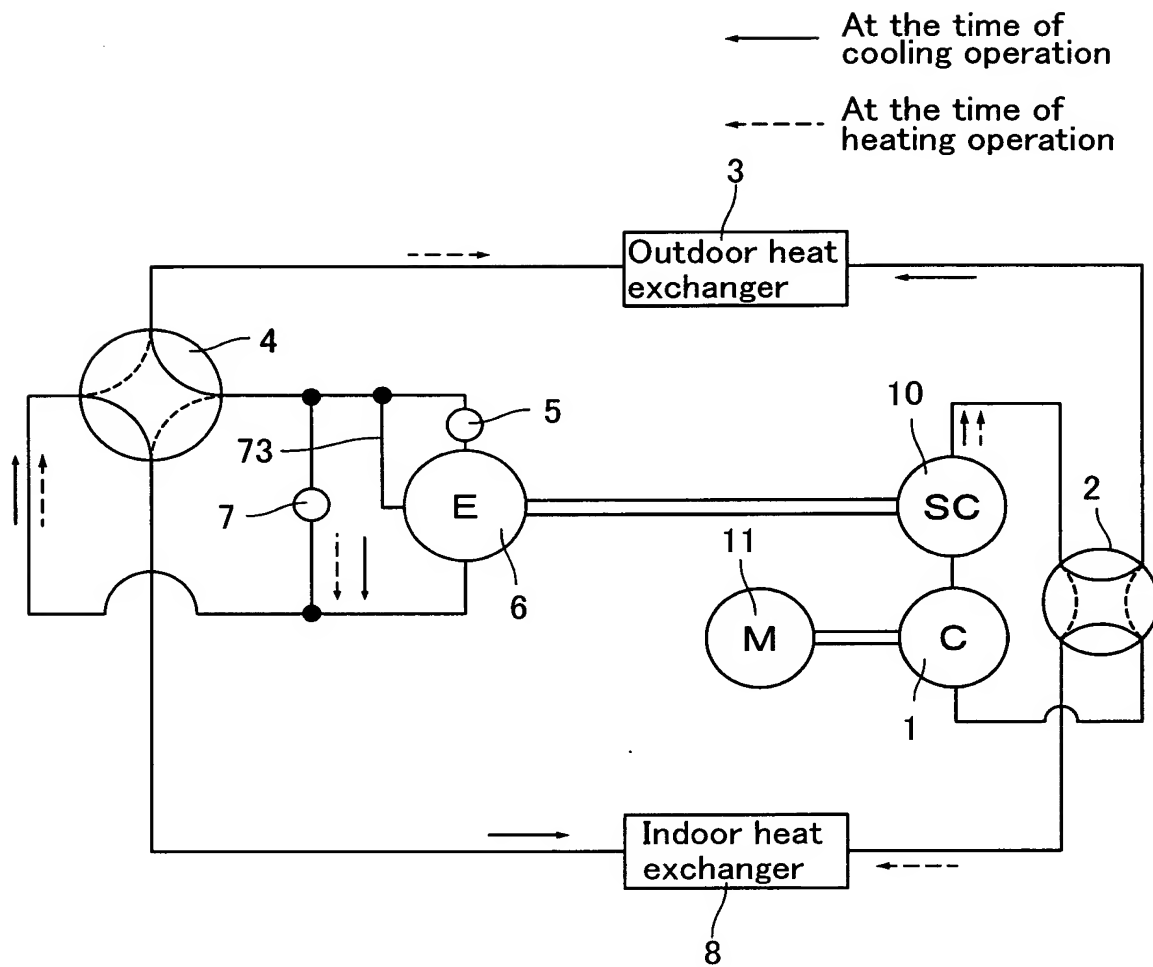


Fig. 6

